


-15kV TOF: -9116 v  
 -3.6kV MCP: -2578 v  
 -2.4kV MCP: -1589 v  
 Input Cur: 306 ma  
 RPA max: 237 v  
 Mirror max: 238 v

Wed Jan 21 07:08:47 2004

## TIDE Direct Events

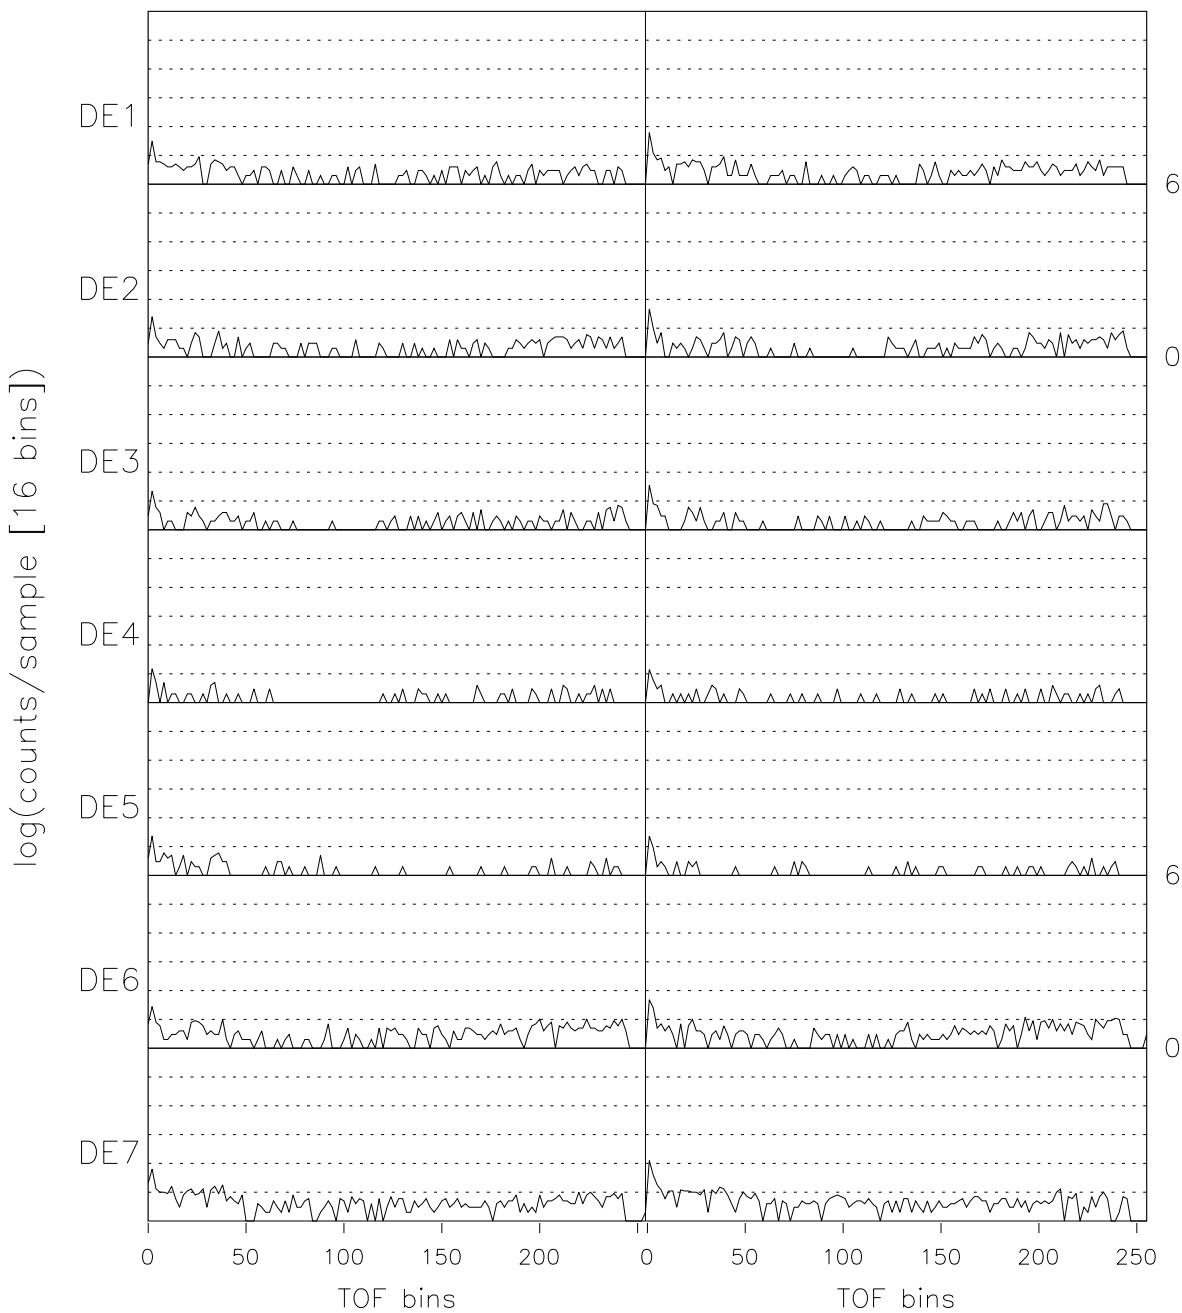

reported: 02-14-97 23:40:01 UT

reported: 02-14-97 23:43:13 UT

file: /export/data/tide/nrt/97021401.dat

-15kV TOF: -9116 v

-3.6kV MCP: -2578 v

-2.4kV MCP: -1579 v

Input Cur: 292 ma

RPA max: 237 v

Mirror max: 238 v